


TYPE-9

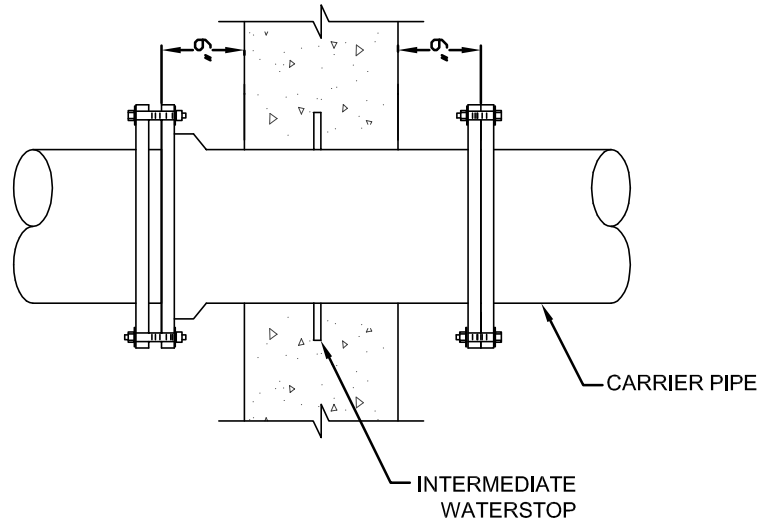

NOTES:

INTERMEDIATE WATERSTOP TO BE CENTERED WITHIN WALL
UNLESS NOTED OTHERWISE.

DUCTILE IRON WALL PIPES SHALL BE USED
FOR 4" DIAMETER AND LARGER PIPING UNLESS NOTED
OTHERWISE.

MINIMUM CLEARANCE DEPENDS UPON PIPE SIZE.

MJ x FL PIPE WALL PENETRATION



BUTLER COUNTY
WATER AND SEWER

130 HIGH STREET
HAMILTON, OH 45011
TELEPHONE: 513-887-3066
FAX: 513-887-3777

4250